

## CERTIFICATE OF ANALYSIS

<b>REPORTED TO</b>	Glenmore Ellison Improvement District 445 Glenmore Road KELOWNA, BC V1V 1Z6	<b>WORK ORDER</b>	24J2538
<b>ATTENTION</b>	Chris Mackay	<b>RECEIVED / TEMP REPORTED</b>	2024-10-18 12:04 / 9.8°C 2024-10-25 15:38
<b>PO NUMBER</b>		<b>COC NUMBER</b>	eCOC#00017556
<b>PROJECT</b>	Drinking Water		
<b>PROJECT INFO</b>	Comprehensive Samples - Okanagan Lake Source		

### Introduction:

CARO Analytical Services is a testing laboratory full of smart, engaged scientists driven to make the world a safer and healthier place. Through our clients' projects we become an essential element for a better world. We employ methods conducted in accordance with recognized professional standards using accepted testing methodologies and quality control efforts. CARO is accredited by the Canadian Association for Laboratories Accreditation (CALA) to ISO/IEC 17025:2017 for specific tests listed in the scope of accreditation approved by CALA.

#### Big Picture Sidekicks



You know that the sample you collected after snowshoeing to site, digging 5 meters, and racing to get it on a plane so you can submit it to the lab for time sensitive results needed to make important and expensive decisions (whew) is VERY important. We know that too.

#### We've Got Chemistry



It's simple. We figure the more you enjoy working with our fun and engaged team members; the more likely you are to give us continued opportunities to support you.

#### Ahead of the Curve



Through research, regulation knowledge, and instrumentation, we are your analytical centre for the technical knowledge you need, BEFORE you need it, so you can stay up to date and in the know.

By engaging our services, you are agreeing to CARO Analytical Service's Standard Terms and Conditions outlined here:  
<https://www.caro.ca/terms-conditions>

If you have any questions or concerns, please contact me at [bwhitehead@caro.ca](mailto:bwhitehead@caro.ca)

#### Authorized By:

Brent Whitehead  
Account Manager

1-888-311-8846 | [www.caro.ca](http://www.caro.ca)

#110 4011 Viking Way Richmond, BC V6V 2K9 | #102 3677 Highway 97N Kelowna, BC V1X 5C3 | 17225 109 Avenue Edmonton, AB T5S 1H7 |  
#108 4475 Wayburne Drive Burnaby, BC V5G 4X4

## TEST RESULTS

**REPORTED TO PROJECT** Glenmore Ellison Improvement District  
Drinking Water

**WORK ORDER REPORTED** 24J2538  
2024-10-25 15:38

Analyte	Result	Guideline	RL	Units	Analyzed	Qualifier
---------	--------	-----------	----	-------	----------	-----------

### Okanagan Lake P/S (RAW) (24J2538-01) | Matrix: Drinking Water | Sampled: 2024-10-18 10:30

#### Anions

Chloride	5.85	AO ≤ 250	0.10	mg/L	2024-10-18	
Fluoride	0.21	MAC = 1.5	0.10	mg/L	2024-10-18	
Nitrate (as N)	0.105	MAC = 10	0.010	mg/L	2024-10-18	
Nitrite (as N)	< 0.010	MAC = 1	0.010	mg/L	2024-10-18	
Sulfate	29.9	AO ≤ 500	1.0	mg/L	2024-10-18	

#### Calculated Parameters

Hardness, Total (as CaCO <sub>3</sub> )	128	None Required	0.500	mg/L	N/A	
Langelier Index	-0.1	N/A	-5.0		2024-10-25	CT6
Solids, Total Dissolved	161	AO ≤ 500	1.00	mg/L	N/A	

#### General Parameters

Alkalinity, Total (as CaCO <sub>3</sub> )	107	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Phenolphthalein (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Bicarbonate (as CaCO <sub>3</sub> )	107	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Carbonate (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Hydroxide (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Colour, True	< 5.0	AO ≤ 15	5.0	CU	2024-10-20	
Conductivity (EC)	299	N/A	2.0	µS/cm	2024-10-23	
Cyanide, Total	< 0.0020	MAC = 0.2	0.0020	mg/L	2024-10-21	
pH	7.89	7.0-10.5	0.10	pH units	2024-10-23	HT2
Temperature, at pH	21.7	N/A		°C	2024-10-23	HT2
Turbidity	0.42	OG < 1	0.10	NTU	2024-10-20	

#### Total Metals

Aluminum, total	< 0.0050	OG < 0.1	0.0050	mg/L	2024-10-21	
Antimony, total	< 0.00020	MAC = 0.006	0.00020	mg/L	2024-10-21	
Arsenic, total	< 0.00050	MAC = 0.01	0.00050	mg/L	2024-10-21	
Barium, total	0.0230	MAC = 2	0.0050	mg/L	2024-10-21	
Boron, total	< 0.0500	MAC = 5	0.0500	mg/L	2024-10-21	
Cadmium, total	< 0.000010	MAC = 0.007	0.000010	mg/L	2024-10-21	
Calcium, total	35.0	None Required	0.20	mg/L	2024-10-21	
Chromium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2024-10-21	
Cobalt, total	< 0.00010	N/A	0.00010	mg/L	2024-10-21	
Copper, total	0.00145	MAC = 2	0.00040	mg/L	2024-10-21	
Iron, total	< 0.010	AO ≤ 0.3	0.010	mg/L	2024-10-21	
Lead, total	< 0.00020	MAC = 0.005	0.00020	mg/L	2024-10-21	
Magnesium, total	9.75	None Required	0.010	mg/L	2024-10-21	
Manganese, total	0.00094	MAC = 0.12	0.00020	mg/L	2024-10-21	
Mercury, total	< 0.000010	MAC = 0.001	0.000010	mg/L	2024-10-20	
Molybdenum, total	0.00365	N/A	0.00010	mg/L	2024-10-21	
Nickel, total	< 0.00040	N/A	0.00040	mg/L	2024-10-21	
Potassium, total	2.58	N/A	0.10	mg/L	2024-10-21	
Selenium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2024-10-21	

## TEST RESULTS

**REPORTED TO PROJECT** Glenmore Ellison Improvement District  
Drinking Water

**WORK ORDER REPORTED** 24J2538  
2024-10-25 15:38

Analyte	Result	Guideline	RL	Units	Analyzed	Qualifier
---------	--------	-----------	----	-------	----------	-----------

### Okanagan Lake P/S (RAW) (24J2538-01) | Matrix: Drinking Water | Sampled: 2024-10-18 10:30, Continued

#### Total Metals, Continued

Sodium, total	12.0	AO ≤ 200	0.10	mg/L	2024-10-21	
Strontium, total	0.282	MAC = 7	0.0010	mg/L	2024-10-21	
Uranium, total	0.00255	MAC = 0.02	0.000020	mg/L	2024-10-21	
Zinc, total	< 0.0040	AO ≤ 5	0.0040	mg/L	2024-10-21	

### UV Plant (PRE UV - RAW) Sink (24J2538-02) | Matrix: Drinking Water | Sampled: 2024-10-18 10:50

#### Anions

Chloride	5.82	AO ≤ 250	0.10	mg/L	2024-10-18	
Fluoride	0.26	MAC = 1.5	0.10	mg/L	2024-10-18	
Nitrate (as N)	0.105	MAC = 10	0.010	mg/L	2024-10-18	
Nitrite (as N)	< 0.010	MAC = 1	0.010	mg/L	2024-10-18	
Sulfate	29.8	AO ≤ 500	1.0	mg/L	2024-10-18	

#### Calculated Parameters

Hardness, Total (as CaCO <sub>3</sub> )	123	None Required	0.500	mg/L	N/A	
Langelier Index	-0.2	N/A	-5.0		2024-10-25	CT6
Solids, Total Dissolved	158	AO ≤ 500	1.00	mg/L	N/A	

#### General Parameters

Alkalinity, Total (as CaCO <sub>3</sub> )	106	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Phenolphthalein (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Bicarbonate (as CaCO <sub>3</sub> )	106	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Carbonate (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Hydroxide (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Colour, True	< 5.0	AO ≤ 15	5.0	CU	2024-10-20	
Conductivity (EC)	297	N/A	2.0	µS/cm	2024-10-23	
Cyanide, Total	< 0.0020	MAC = 0.2	0.0020	mg/L	2024-10-21	
pH	7.84	7.0-10.5	0.10	pH units	2024-10-23	HT2
Temperature, at pH	21.4	N/A		°C	2024-10-23	HT2
Turbidity	0.21	OG < 1	0.10	NTU	2024-10-20	

#### Total Metals

Aluminum, total	< 0.0050	OG < 0.1	0.0050	mg/L	2024-10-22	
Antimony, total	< 0.00020	MAC = 0.006	0.00020	mg/L	2024-10-22	
Arsenic, total	< 0.00050	MAC = 0.01	0.00050	mg/L	2024-10-22	
Barium, total	0.0235	MAC = 2	0.0050	mg/L	2024-10-22	
Boron, total	< 0.0500	MAC = 5	0.0500	mg/L	2024-10-22	
Cadmium, total	< 0.000010	MAC = 0.007	0.000010	mg/L	2024-10-22	
Calcium, total	33.8	None Required	0.20	mg/L	2024-10-22	
Chromium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2024-10-22	
Cobalt, total	< 0.00010	N/A	0.00010	mg/L	2024-10-22	
Copper, total	0.00114	MAC = 2	0.00040	mg/L	2024-10-22	
Iron, total	< 0.010	AO ≤ 0.3	0.010	mg/L	2024-10-22	

## TEST RESULTS

**REPORTED TO PROJECT** Glenmore Ellison Improvement District  
Drinking Water

**WORK ORDER REPORTED** 24J2538  
2024-10-25 15:38

Analyte	Result	Guideline	RL	Units	Analyzed	Qualifier
---------	--------	-----------	----	-------	----------	-----------

### UV Plant (PRE UV - RAW) Sink (24J2538-02) | Matrix: Drinking Water | Sampled: 2024-10-18 10:50, Continued

#### Total Metals, Continued

Lead, total	< 0.00020	MAC = 0.005	0.00020	mg/L	2024-10-22	
Magnesium, total	9.37	None Required	0.010	mg/L	2024-10-22	
Manganese, total	0.00090	MAC = 0.12	0.00020	mg/L	2024-10-22	
Mercury, total	< 0.000010	MAC = 0.001	0.000010	mg/L	2024-10-20	
Molybdenum, total	0.00345	N/A	0.00010	mg/L	2024-10-22	
Nickel, total	0.00051	N/A	0.00040	mg/L	2024-10-22	
Potassium, total	2.49	N/A	0.10	mg/L	2024-10-22	
Selenium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2024-10-22	
Sodium, total	11.9	AO ≤ 200	0.10	mg/L	2024-10-22	
Strontium, total	0.275	MAC = 7	0.0010	mg/L	2024-10-22	
Uranium, total	0.00244	MAC = 0.02	0.000020	mg/L	2024-10-22	
Zinc, total	< 0.0040	AO ≤ 5	0.0040	mg/L	2024-10-22	

### Clearwell Outflow (24J2538-03) | Matrix: Drinking Water | Sampled: 2024-10-18 11:10

#### Anions

Chloride	8.11	AO ≤ 250	0.10	mg/L	2024-10-18	
Fluoride	0.41	MAC = 1.5	0.10	mg/L	2024-10-18	
Nitrate (as N)	< 0.010	MAC = 10	0.010	mg/L	2024-10-18	
Nitrite (as N)	< 0.010	MAC = 1	0.010	mg/L	2024-10-18	
Sulfate	33.0	AO ≤ 500	1.0	mg/L	2024-10-18	

#### Calculated Parameters


Hardness, Total (as CaCO <sub>3</sub> )	126	None Required	0.500	mg/L	N/A	
Langelier Index	-0.2	N/A	-5.0		2024-10-25	CT6
Solids, Total Dissolved	164	AO ≤ 500	10.0	mg/L	N/A	

#### General Parameters

Alkalinity, Total (as CaCO <sub>3</sub> )	104	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Phenolphthalein (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Bicarbonate (as CaCO <sub>3</sub> )	104	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Carbonate (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Alkalinity, Hydroxide (as CaCO <sub>3</sub> )	< 1.0	N/A	1.0	mg/L	2024-10-23	
Colour, True	< 5.0	AO ≤ 15	5.0	CU	2024-10-20	
Conductivity (EC)	299	N/A	2.0	µS/cm	2024-10-23	
Cyanide, Total	< 0.0020	MAC = 0.2	0.0020	mg/L	2024-10-21	
pH	7.82	7.0-10.5	0.10	pH units	2024-10-23	HT2
Temperature, at pH	21.3	N/A		°C	2024-10-23	HT2
Turbidity	0.46	OG < 1	0.10	NTU	2024-10-20	

#### Total Metals

Aluminum, total	< 0.0050	OG < 0.1	0.0050	mg/L	2024-10-20	
Antimony, total	< 0.00020	MAC = 0.006	0.00020	mg/L	2024-10-20	

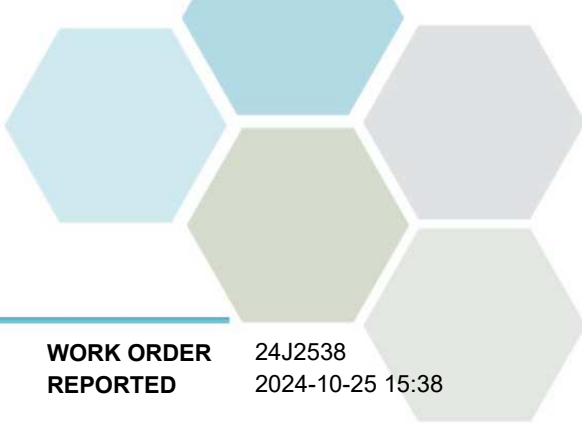

# TEST RESULTS

REPORTED TO PROJECT	Glenmore Ellison Improvement District Drinking Water	WORK ORDER REPORTED	24J2538 2024-10-25 15:38
---------------------	---------------------------------------------------------	---------------------	-----------------------------

Analyte	Result	Guideline	RL	Units	Analyzed	Qualifier
---------	--------	-----------	----	-------	----------	-----------

Clearwell Outflow (24J2538-03) | Matrix: Drinking Water | Sampled: 2024-10-18 11:10, Continued

Total Metals, Continued

Arsenic, total	0.00052	MAC = 0.01	0.00050	mg/L	2024-10-20	
Barium, total	0.0221	MAC = 2	0.0050	mg/L	2024-10-20	
Boron, total	< 0.0500	MAC = 5	0.0500	mg/L	2024-10-20	
Cadmium, total	< 0.000010	MAC = 0.007	0.000010	mg/L	2024-10-20	
Calcium, total	34.8	None Required	0.20	mg/L	2024-10-20	
Chromium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2024-10-20	
Cobalt, total	< 0.00010	N/A	0.00010	mg/L	2024-10-20	
Copper, total	0.00146	MAC = 2	0.00040	mg/L	2024-10-20	
Iron, total	< 0.010	AO ≤ 0.3	0.010	mg/L	2024-10-20	
Lead, total	< 0.00020	MAC = 0.005	0.00020	mg/L	2024-10-20	
Magnesium, total	9.57	None Required	0.010	mg/L	2024-10-20	
Manganese, total	0.00087	MAC = 0.12	0.00020	mg/L	2024-10-20	
Mercury, total	< 0.000010	MAC = 0.001	0.000010	mg/L	2024-10-20	
Molybdenum, total	0.00352	N/A	0.00010	mg/L	2024-10-20	
Nickel, total	0.00045	N/A	0.00040	mg/L	2024-10-20	
Potassium, total	2.45	N/A	0.10	mg/L	2024-10-20	
Selenium, total	< 0.00050	MAC = 0.05	0.00050	mg/L	2024-10-20	
Sodium, total	12.3	AO ≤ 200	0.10	mg/L	2024-10-20	
Strontium, total	0.308	MAC = 7	0.0010	mg/L	2024-10-20	
Uranium, total	0.00246	MAC = 0.02	0.000020	mg/L	2024-10-20	
Zinc, total	< 0.0040	AO ≤ 5	0.0040	mg/L	2024-10-20	

Sample Qualifiers:	
CT6	Results were based on lab temperature & lab pH.
HT2	The 15 minute recommended holding time (from sampling to analysis) has been exceeded - field analysis is recommended.

## APPENDIX 1: SUPPORTING INFORMATION

**REPORTED TO PROJECT** Glenmore Ellison Improvement District  
Drinking Water


**WORK ORDER REPORTED** 24J2538  
2024-10-25 15:38

Analysis Description	Method Ref.	Technique	Accredited	Location
Alkalinity in Water	SM 2320 B* (2021)	Titration with H2SO4	✓	Kelowna
Anions in Water	SM 4110 B (2020)	Ion Chromatography	✓	Kelowna
Colour, True in Water	SM 2120 C (2021)	Spectrophotometry (456 nm)	✓	Kelowna
Conductivity in Water	SM 2510 B (2021)	Conductivity Meter	✓	Kelowna
Cyanide, SAD in Water	ASTM D7511-12	Flow Injection with In-Line UV Digestion and Amperometry	✓	Kelowna
Hardness in Water	SM 2340 B* (2021)	Calculation: 2.497 [total Ca] + 4.118 [total Mg] (Est)	✓	N/A
Langelier Index in Water	SM 2330 B (2021)	Calculation		N/A
Mercury, total in Water	EPA 245.7*	BrCl2 Oxidation / Cold Vapor Atomic Fluorescence Spectrometry (CVAFS)	✓	Richmond
pH in Water	SM 4500-H+ B (2021)	Electrometry	✓	Kelowna
Solids, Total Dissolved in Water	SM 1030 E (2021)	SM 1030 E		N/A
Total Metals in Water	EPA 200.2 / EPA 6020B	HNO3+HCl Hot Block Digestion / Inductively Coupled Plasma-Mass Spectroscopy (ICP-MS)	✓	Richmond
Turbidity in Water	SM 2130 B (2020)	Nephelometry	✓	Kelowna

*Note: An asterisk in the Method Reference indicates that the CARO method has been modified from the reference method*

### Glossary of Terms:

RL	Reporting Limit (default)
<	Less than the specified Reporting Limit (RL) - the actual RL may be higher than the default RL due to various factors
°C	Degrees Celcius
AO	Aesthetic Objective
CU	Colour Units (referenced against a platinum cobalt standard)
MAC	Maximum Acceptable Concentration (health based)
mg/L	Milligrams per litre
NTU	Nephelometric Turbidity Units
OG	Operational Guideline (treated water)
pH units	pH < 7 = acidic, pH > 7 = basic
µS/cm	Microsiemens per centimetre
ASTM	ASTM International Test Methods
EPA	United States Environmental Protection Agency Test Methods
SM	Standard Methods for the Examination of Water and Wastewater, American Public Health Association

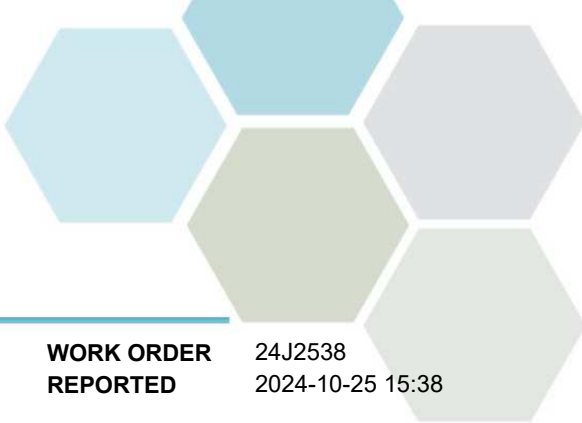

APPENDIX 1: SUPPORTING INFORMATION

REPORTED TO PROJECT	Glenmore Ellison Improvement District Drinking Water	WORK ORDER REPORTED	24J2538 2024-10-25 15:38
---------------------	---------------------------------------------------------	---------------------	-----------------------------

**General Comments:**  
The results in this report apply to the received samples analyzed in accordance with the Chain of Custody document. This analytical report must be reproduced in its entirety. CARO is not responsible for any loss or damage resulting directly or indirectly from error or omission in the conduct of testing. Liability is limited to the cost of analysis. Caro will dispose of all samples within 30 days of sample receipt, unless otherwise agreed. The quality control (QC) data is available upon request

Results in **Bold** indicate values that are above CARO's method reporting limits. Any results that are above regulatory limits are highlighted **red**. Please note that results will only be highlighted red if the regulatory limits are included on the CARO report. Any Bold and/or highlighted results do not take into account method uncertainty. If you would like method uncertainty or regulatory limits to be included on your report, please contact your Account Manager: [bwhitehead@caro.ca](mailto:bwhitehead@caro.ca)

*Please note any regulatory guidelines applied to this report are added as a convenience to the client, at their request, to help provide some initial context to analytical results obtained. Although CARO makes every effort to ensure accuracy of the associated regulatory guideline(s) applied, the guidelines applied cannot be assumed to be correct due to a variety of factors and as such CARO Analytical Services assumes no liability or responsibility for the use of those guidelines to make any decisions. The original source of the regulation should be verified and a review of the guideline(s) should be validated as correct in order to make any decisions arising from the comparison of the analytical data obtained to the relevant regulatory guideline for one's particular circumstances. Further, CARO Analytical Services assumes no liability or responsibility for any loss attributed from the use of these guidelines in any way.*